


PLAN VIEW

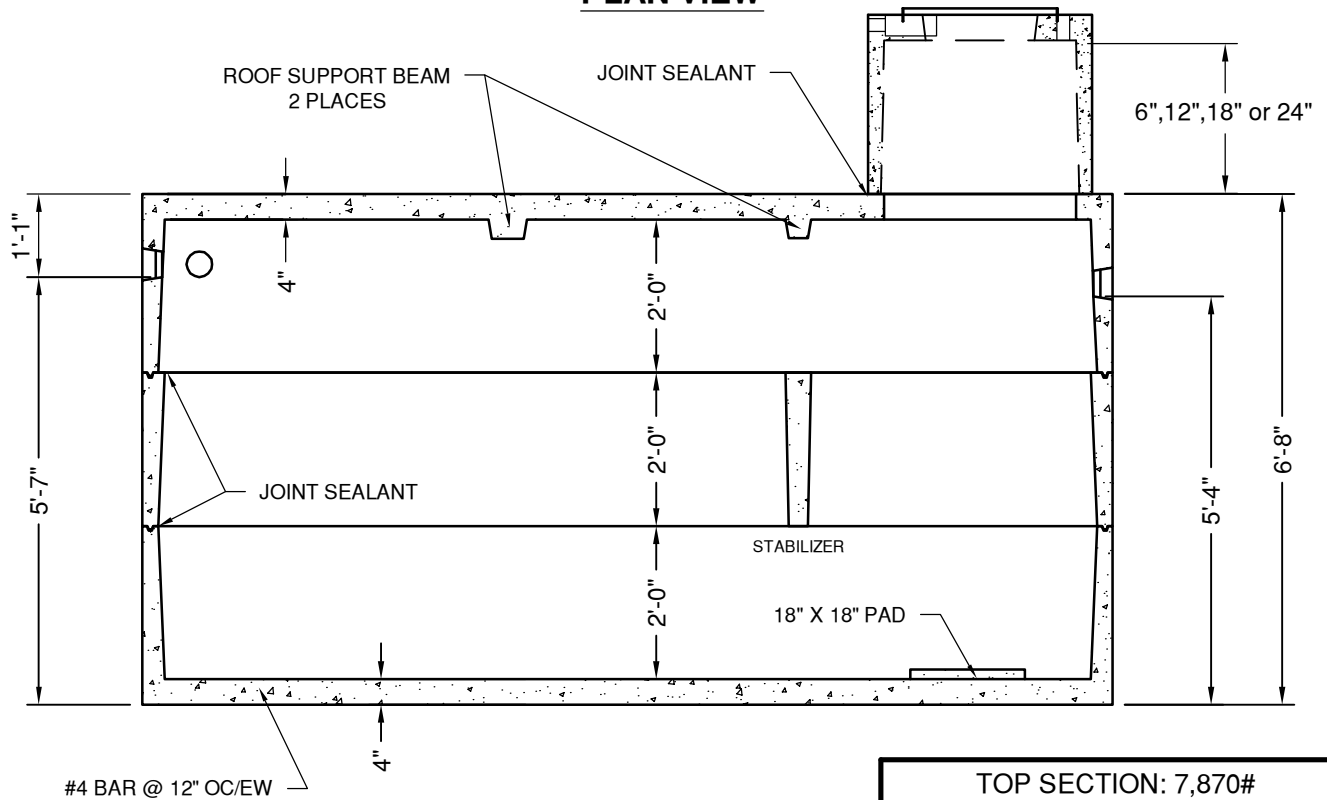

SECTION VIEW

TOP SECTION: 7,870#
RISER SECTION: 3,720#
BOTTOM SECTION: 7,190#
TOTAL WEIGHT: 18,780#

PUMP TANK 2500 GALLON INDIANA
DATE: 4-11-17
DWG #ST-IN-2500-P



"NPCA" CERTIFIED PLANT
 16700 SIMA GRAY RD, HENRYVILLE, IN 47126
 Phone: (812) 246-6258 Fax: (812) 294-4862

SPECIFICATIONS

CONCRETE: 4500 PSI @ 28 DAYS
 REINFORCEMENT: ASTM A-615, GR 60
 LOAD DESIGN: NON-TRAFFIC 18" MAX COVER