


PLAN VIEW



SECTION VIEW

FOR 8-17 SETS OF
SECONDARY CONDUIT
SEE DWG #EL-TP-LGE-7x7
FOR 1-8 SETS OF
SECONDARY CONDUIT

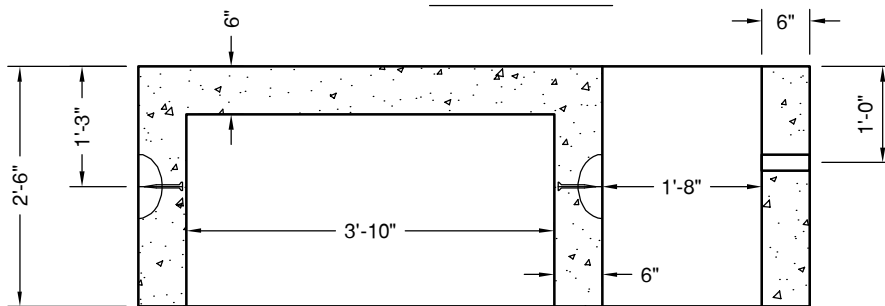

"NPCA" CERTIFIED PLANT
16700 SIMA GRAY RD, HENRYVILLE, IN 47126
Phone: (812) 246-6258 Fax: (812) 294-4862

SPECIFICATIONS

CONCRETE: 4500 PSI @ 28 DAYS
REINFORCEMENT: ASTM A-615, GR 60
DESIGN LOAD: AASHTO HS-20
REF: LG& E STD DWG# 42-06-10
SIZE REF: 75-2500 KVA => 3" DIA TRANSFORMER

WEIGHT: 12,392#

TRANSFORMER PAD
LG&E / KU
7' x 12'

DATE: 3-21-18

DWG #EL-TP-LGE-7x12