


**PLAN VIEW**



**SECTION VIEW**

**MAXIMUM 8 SETS OF  
SECONDARY CONDUIT**  
SEE DWG #EL-TP-LGE-7x12  
FOR 8-17 SETS OF  
SECONDARY CONDUIT

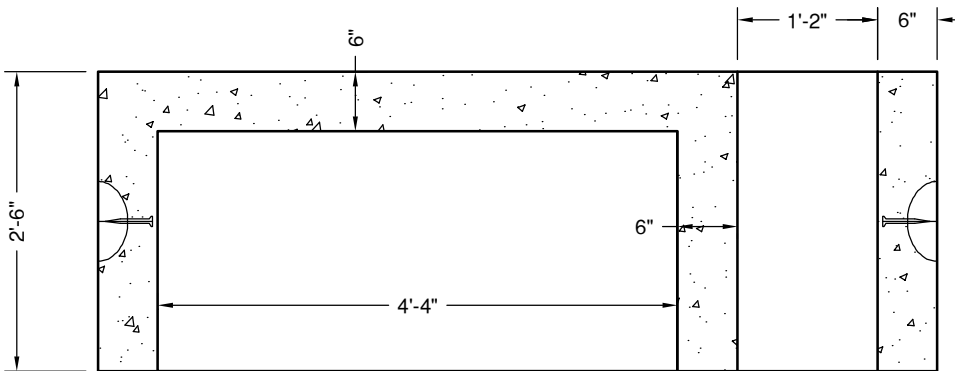

"NPCA" CERTIFIED PLANT  
16700 SIMA GRAY RD, HENRYVILLE, IN 47126  
Phone: (812) 246-6258 Fax: (812) 294-4862

**SPECIFICATIONS**

CONCRETE: 4500 PSI @ 28 DAYS
REINFORCEMENT: ASTM A-615, GR 60
DESIGN LOAD: 17,000 LB Dead Load
REF: LG& E STD DWG# 42-06-04 REV F
SIZE REF: 75-2500 KVA => 3" DIA TRANSFORMER

WEIGHT: 8,970#

**TRANSFORMER PAD**  
**LG&E / KU**  
**7' x 7'**

DATE: 3-21-18

DWG #EL-TP-LGE-7x7